

Griestu plāksnes montāža iekārtai Salla Ceiling mounting of Salla



General information

DANGER

Always check that the supply voltage to the equipment is switched off before opening the service hatch.

WARNING

In case of a malfunction, always determine the reason for the malfunction before restarting the unit.

WARNING

When you have switched off the power to the unit, wait for two (2) minutes before starting the maintenance work. Even though the power is switched off, the fans continue running and the post-heating coil remains hot for a while.

Electrical safety

DANGER

Only an authorised electrician may open the electrical box.

DANGER

Follow the local regulations on electrical installations.

CAUTION


Check that the unit is completely isolated from the mains supply before conducting any voltage tests, insulation resistance measurements or other electrical work or measurements. Such work may damage the sensitive electrical equipment.

CAUTION

Control equipment used in the ventilation units may cause leakage current. This may affect the operation of the residual current protection.

CAUTION

All ventilation units containing a control system must be equipped with an overvoltage protector.

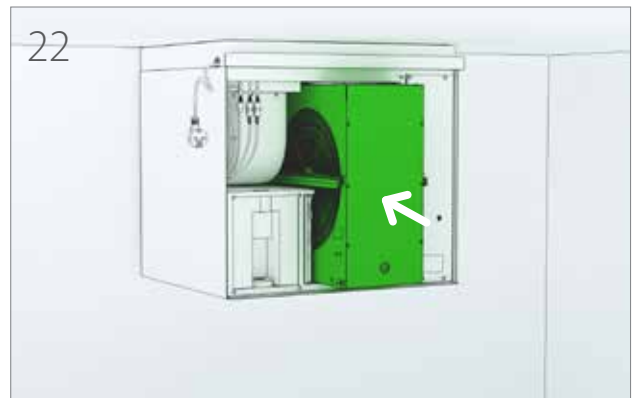





INSTALĀCIJA IEKĀRTAI AR VISRTUVES NOSŪCI






Salla CHC installation

The unit can be installed in the ceiling in accordance with the instructions provided below. The unit may only be disassembled by an authorised maintenance company.



DANGER

Always check that the supply voltage to the equipment is switched off before opening the service hatch.

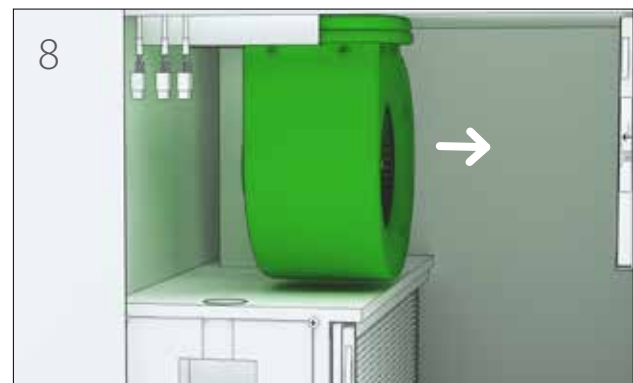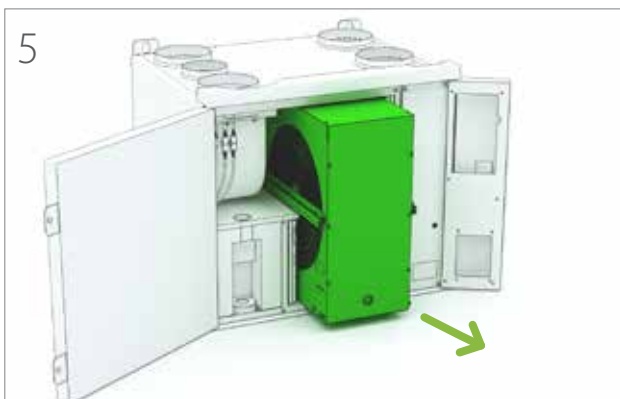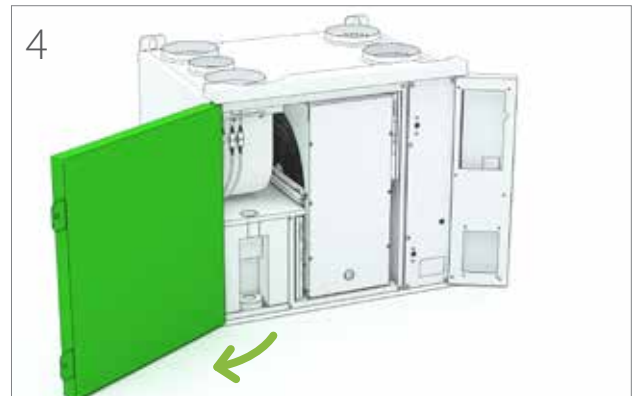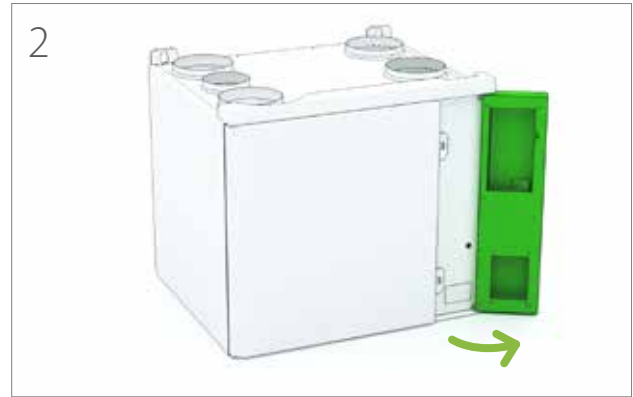

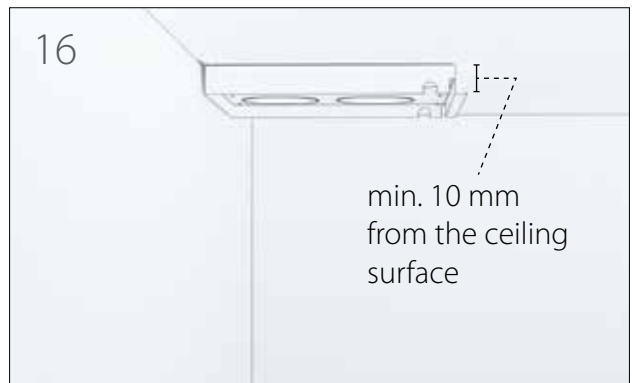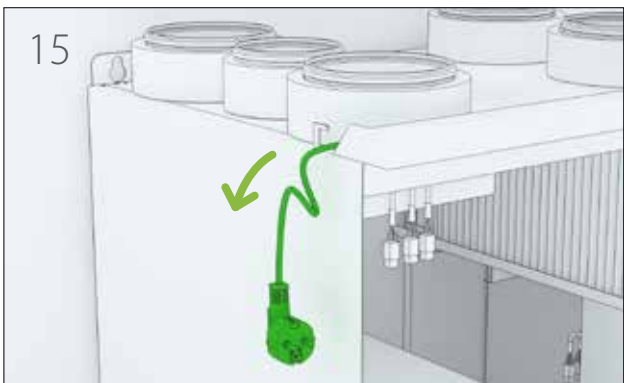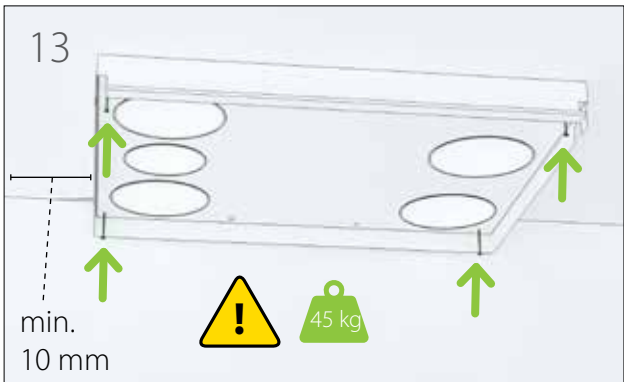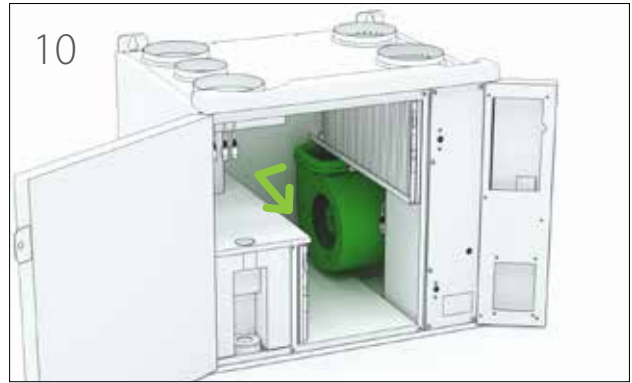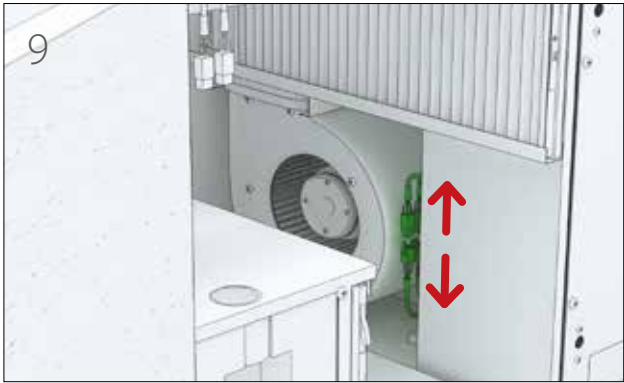

PIEGĀDES SATURS / CONTENTS OF THE DELIVERY

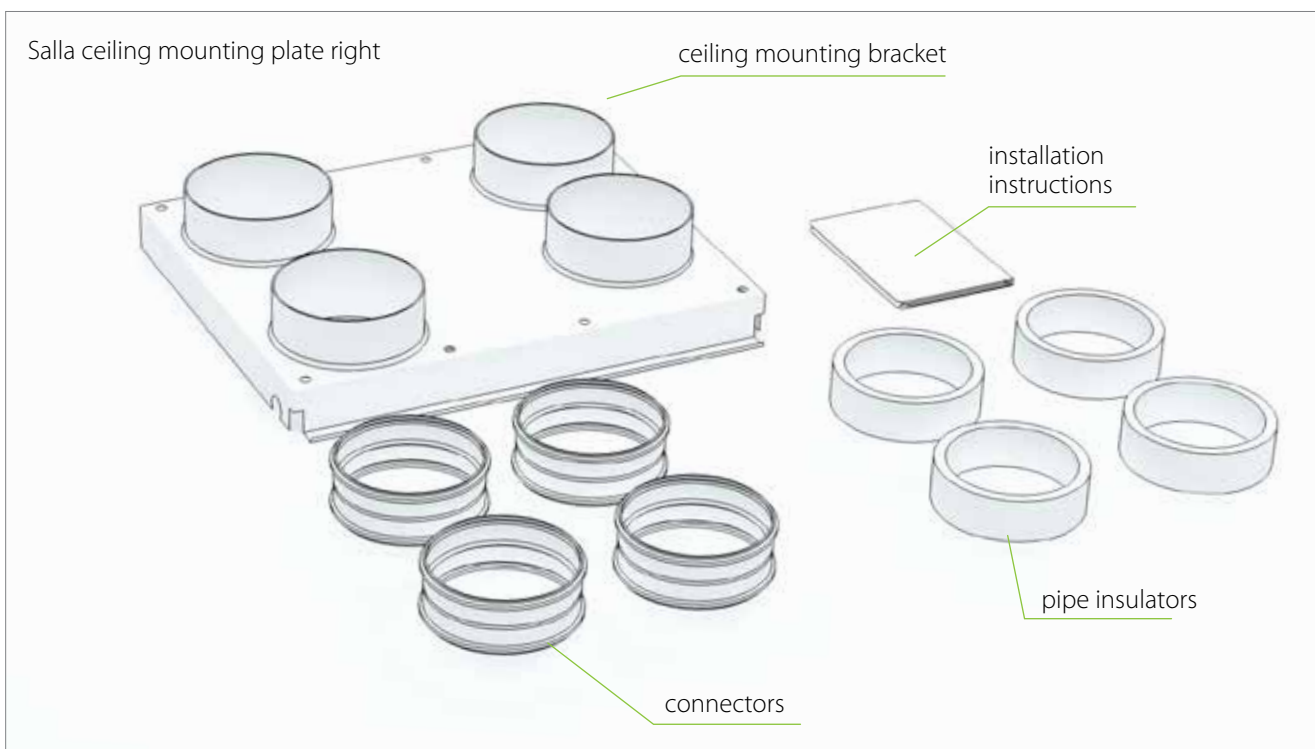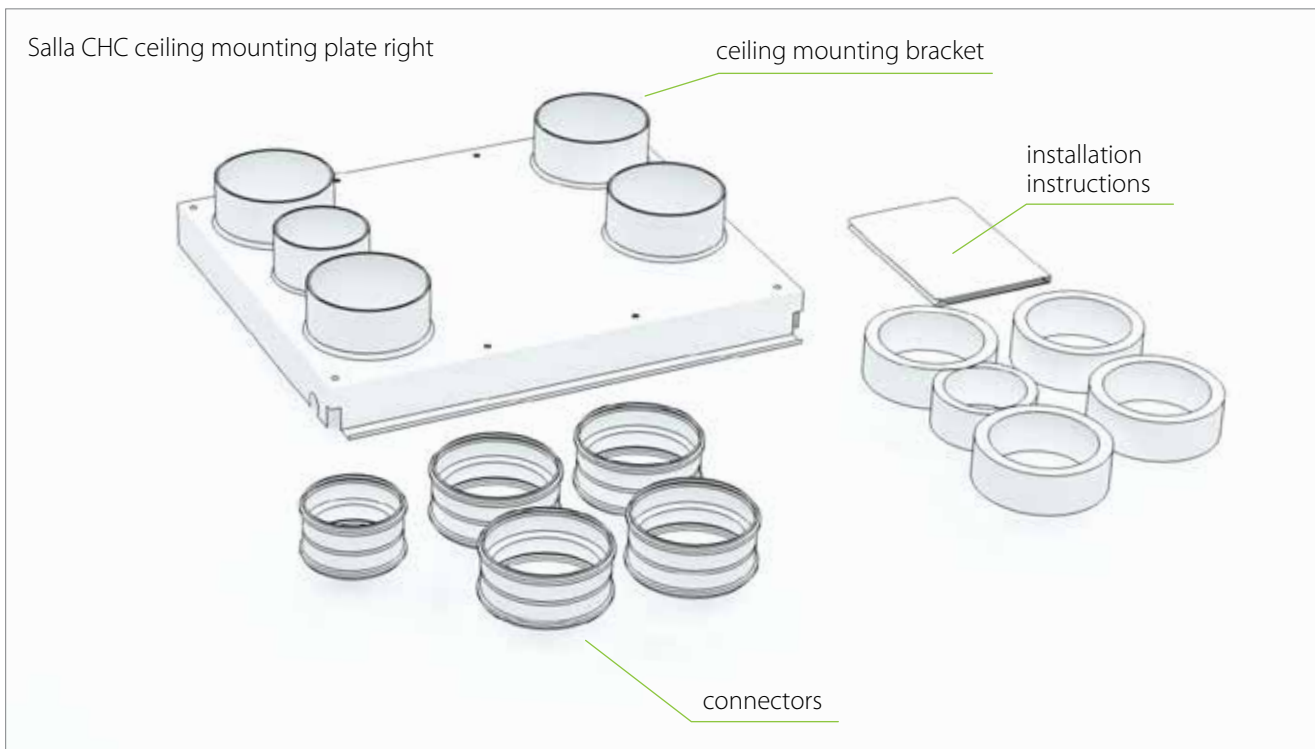


Ceiling mounting plate models

Product number	Product name
K930040202	Salla ceiling mounting plate right
K930040202V	Salla ceiling mounting plate left
K930040207	Salla CHC ceiling mounting plate right
K930040207V	Salla CHC ceiling mounting plate left

GRIEZUMI / DIMENSION DRAWINGS

Salla labā puse ar virtuves nosūci / right handed ventilatin unit with roof mountingplate

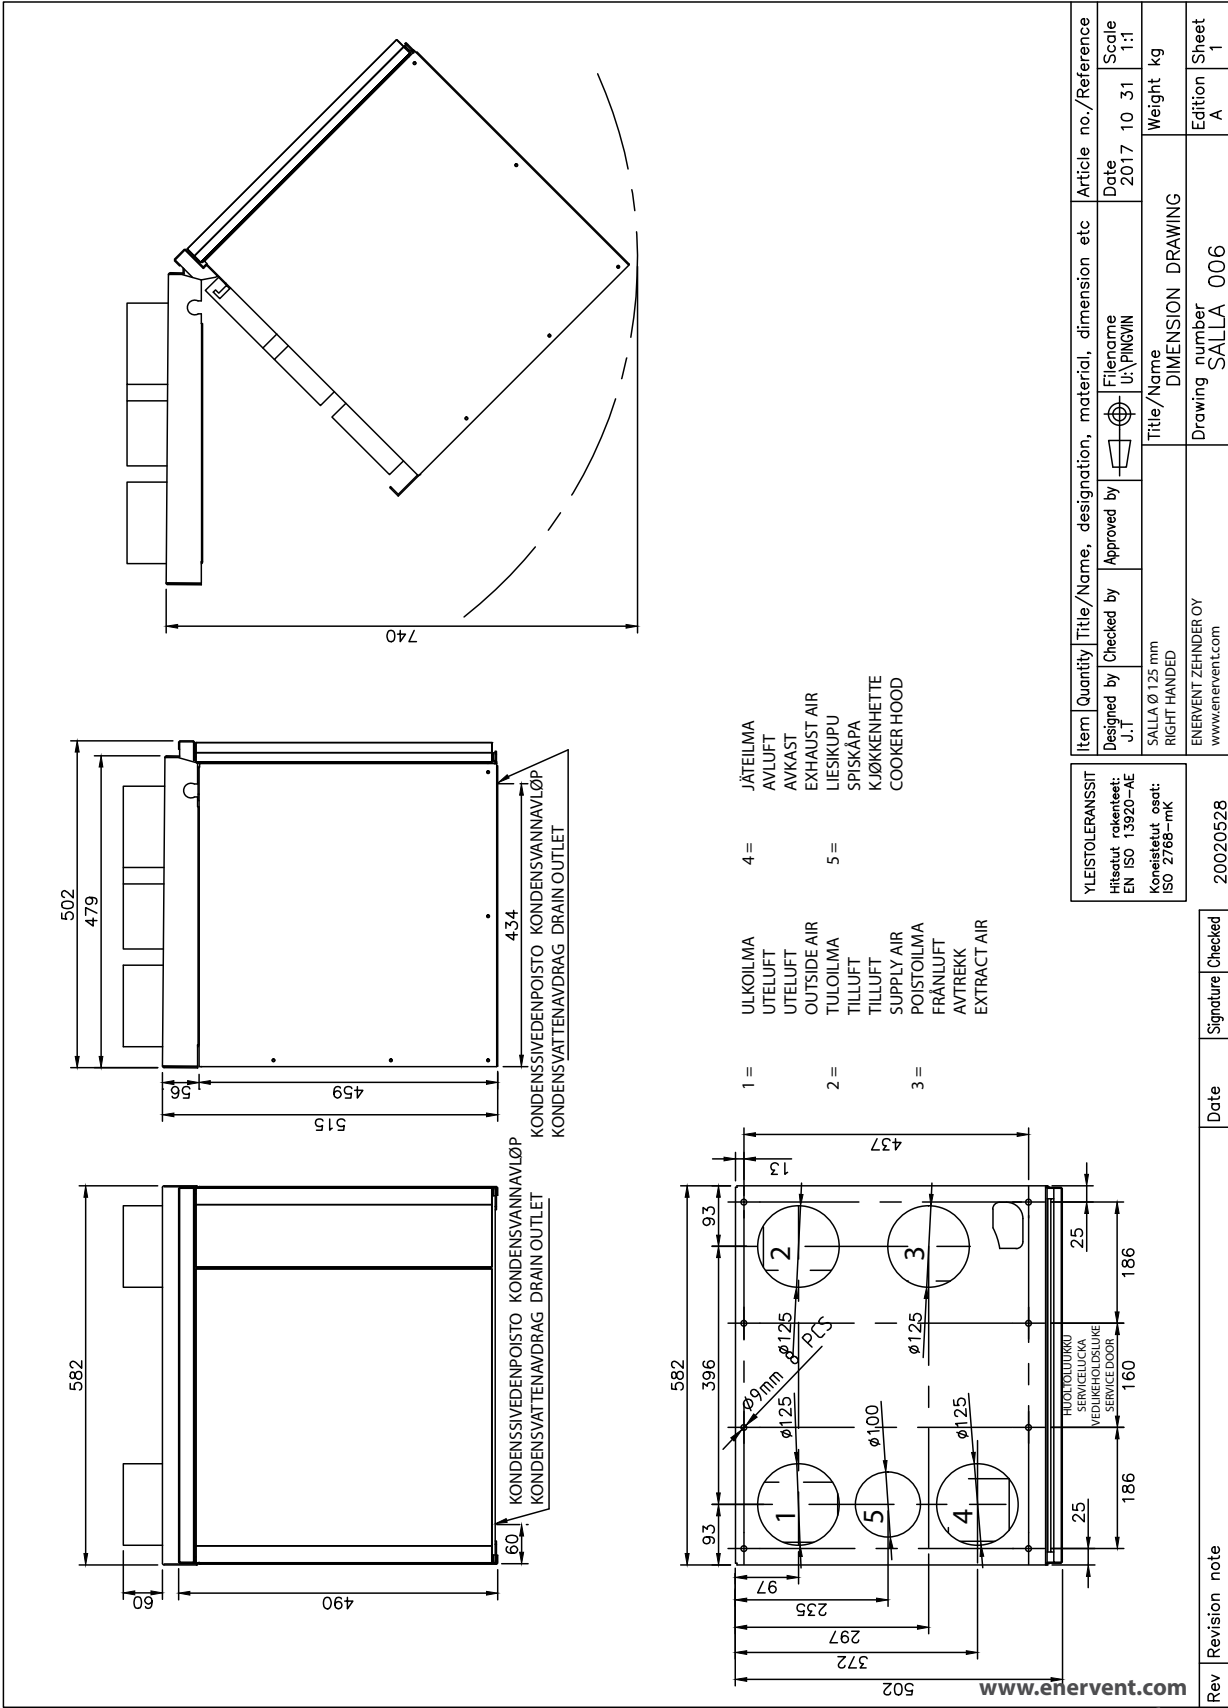




INSTALĀCIJA IEKĀRTAI BEZ VISRTUVES NOSŪCES

Salla installation






The unit can be installed in the ceiling in accordance with the instructions provided below. The unit may only be disassembled by an authorised maintenance company.


DANGER

Always check that the supply voltage to the equipment is switched off before opening the service hatch.

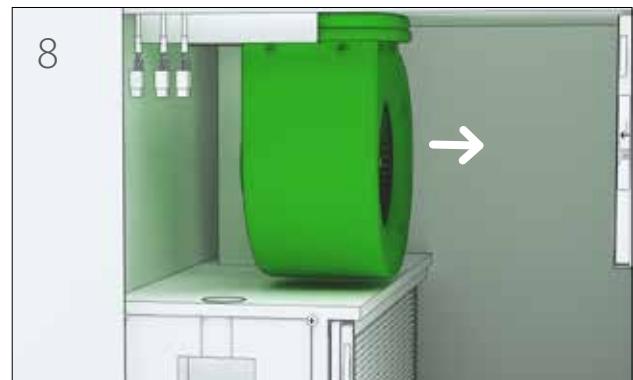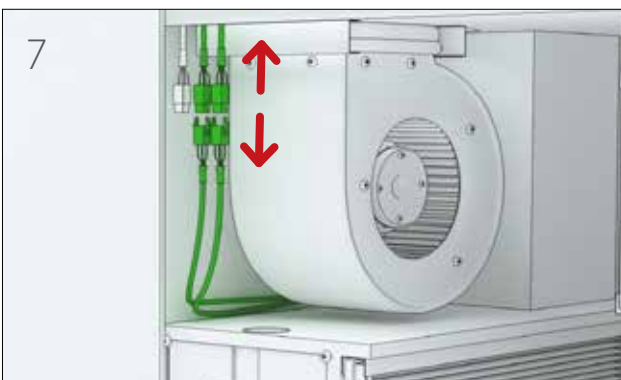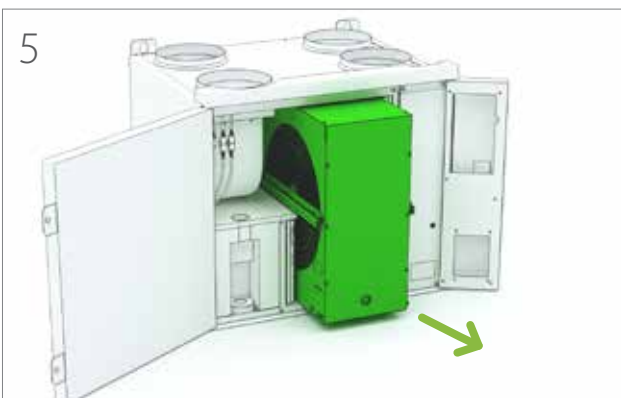


EN

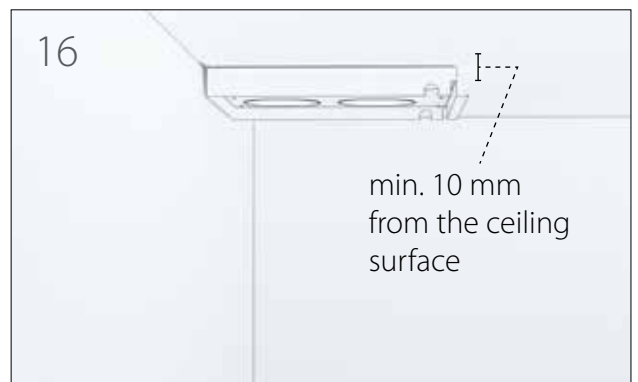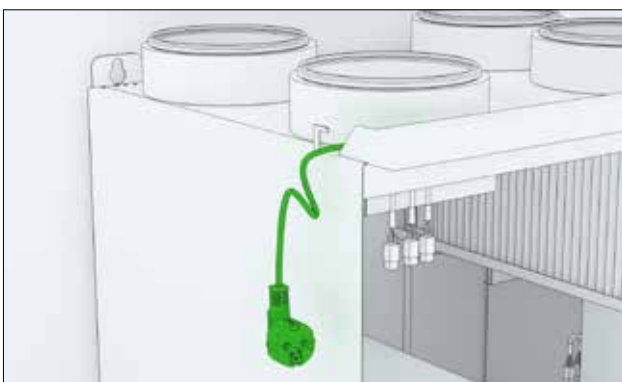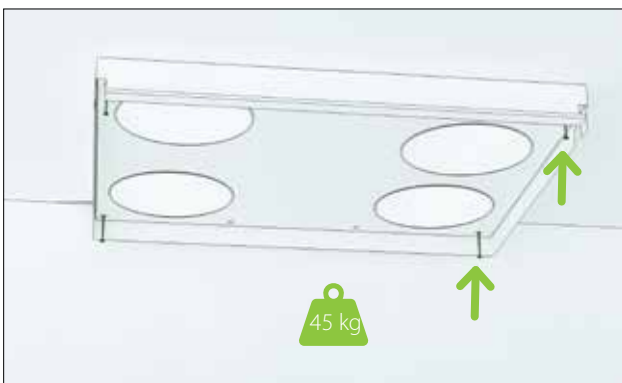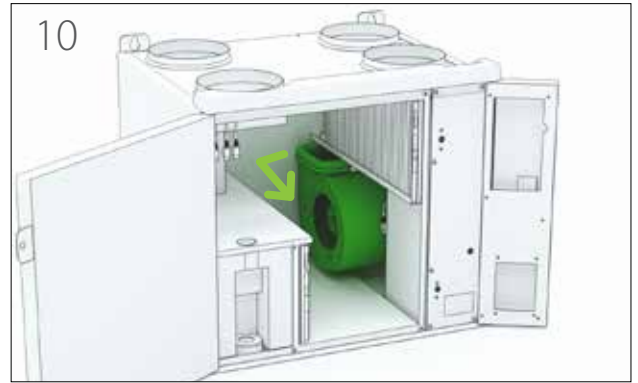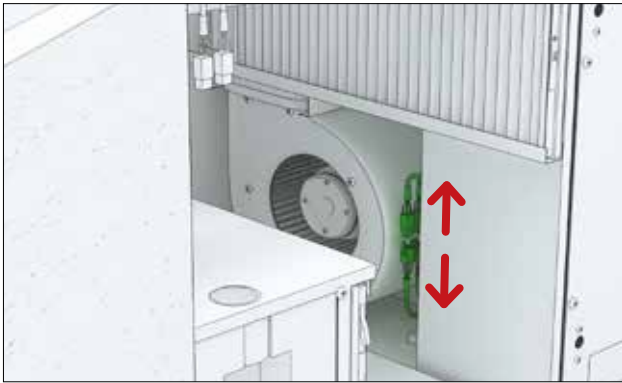

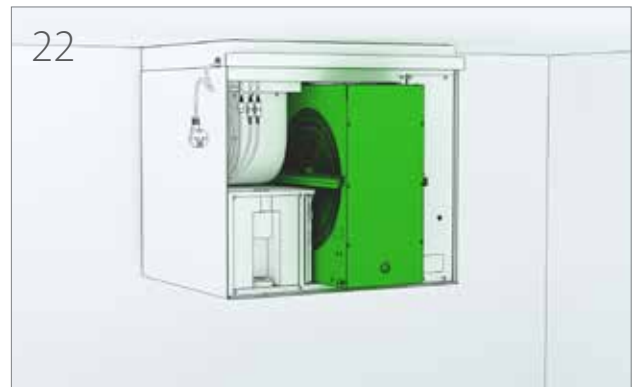

GRIEZUMI / DIMENSION DRAWINGS

Salla labā puse bez virtuves nosūces/ right handed ventilatin unit with roof mountingplate

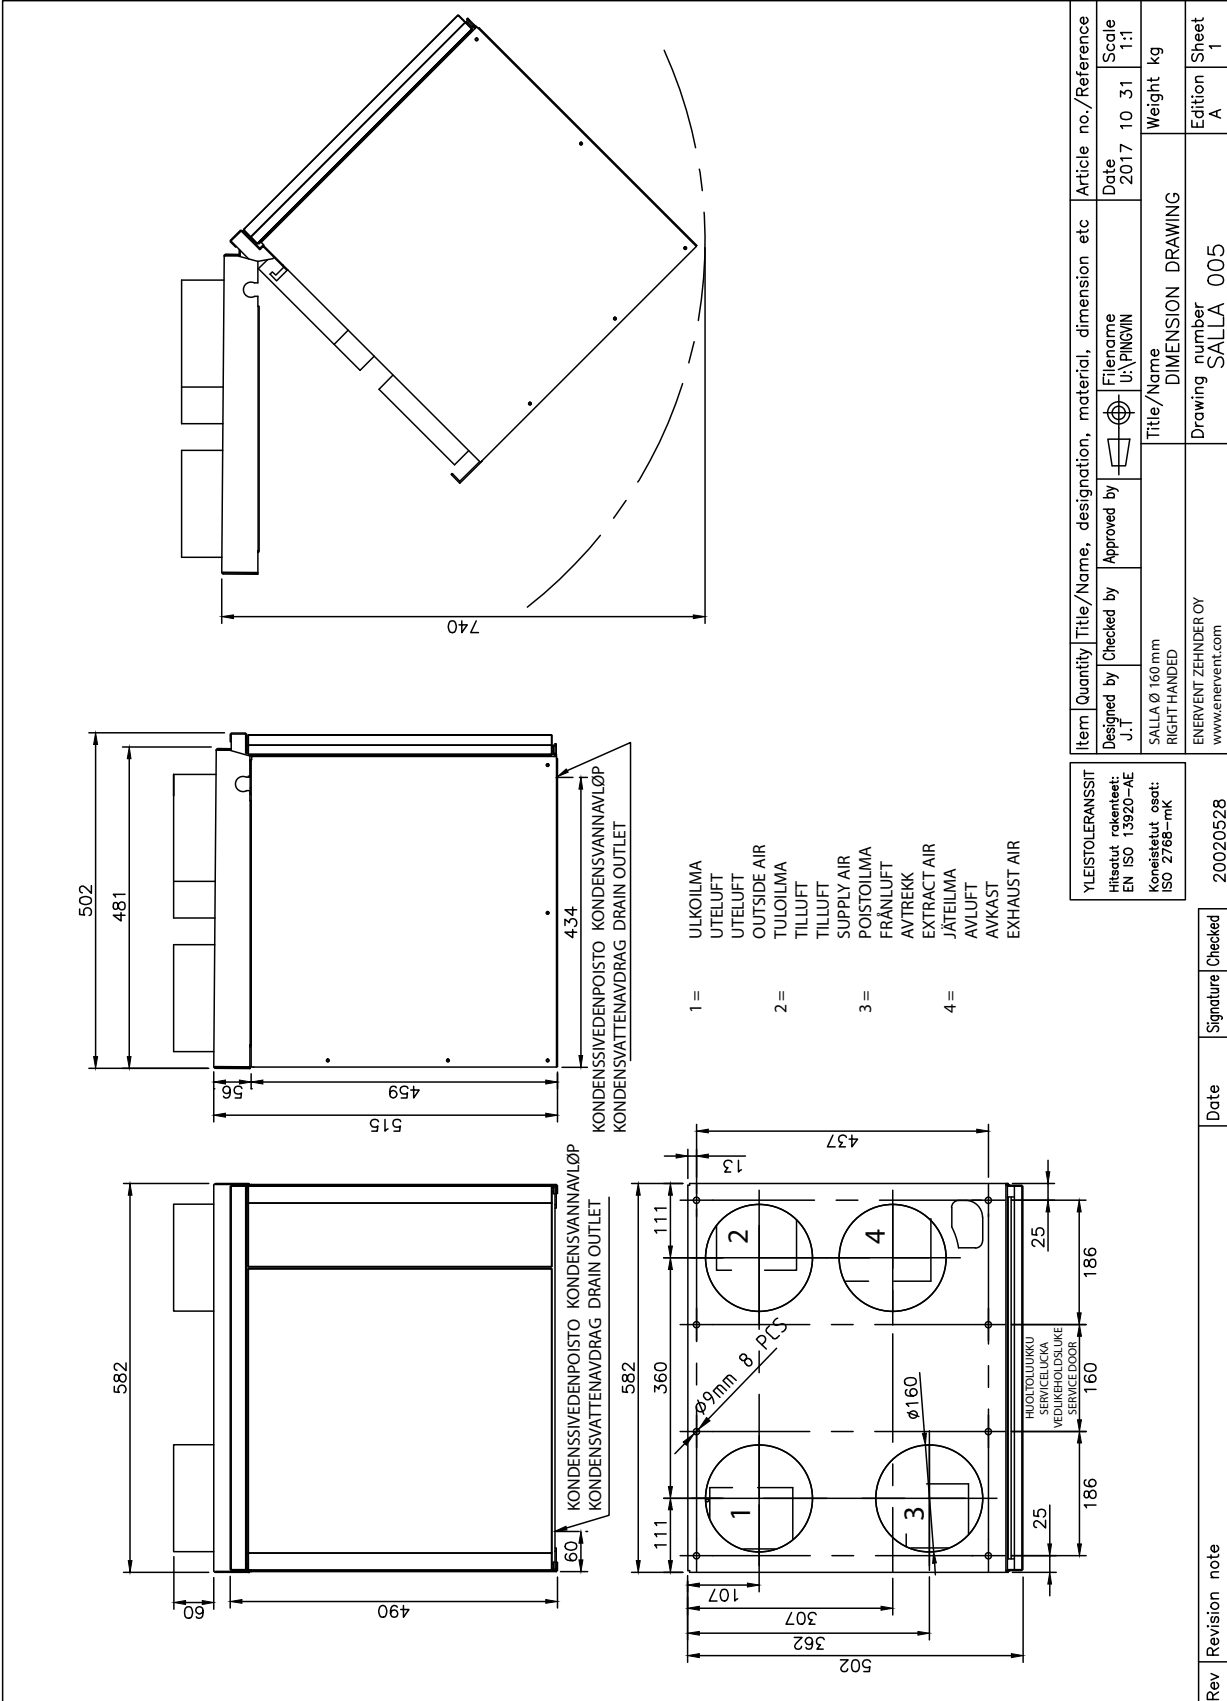



Enervent Zehnder Oy
Kipinätie 1
FIN-06150 Porvoo, Finland

Tel. +358 207 528 800 enervent@enervent.com www.enervent.com

Tel. + 371 29 116 116 info@artiva.lv www.enervent.lv

